

☐ **GFR3500** Heated Safety Station with Eyewash, Stainless Steel Pipe/Fittings, Top Inlet, Rated for Class I, Division 2 Environment

**Application:** Electric heat-traced stations prevent freezing even in extreme conditions. Thermostat regulated units are heated by self-limiting heat-tracing cable wrapped around internal pipe. Units are intended for cold weather use down to -40°F. See 'Tempering Valves' section to ensure tepid water compliance with ANSI Z358.1-2014.

**Heating Cable:** Self-regulated with external termination guards. Thermostat activates when internal piping temperature falls below 75°F. FM, UL, and CSA approved for Class I, Division 2, Groups B, C, and D.

**Electrical System:** Unit is fully wired at factory. Junction box and components rated for Class I, Division 2, Groups B, C, and D. Requires 120 VAC single phase power supply.

**Jacket/Insulation:** UV-resistant orange ABS plastic with polyethylene foam insulation. Jacket sections secured with removable stainless steel screws for easy maintenance.

**Shower Head:** 10" diameter stainless steel with 20 GPM flow control.

**Shower Valve:** 1" IPS chrome-plated brass stay-open ball valve. US-made with brass ball and Teflon® seals. Includes stainless steel actuating arm and 29" stainless steel pull rod.

**Spray Head Assembly:** Freeze-resistant with float-off dust covers and internal flow control.

**Eyewash Valve:** 1/2" IPS chrome-plated brass three-way self-draining stay-open ball valve. US-made with brass ball and Teflon® seals. Includes 1/2" NPT port to drain water from spray heads after use.

Pipe and Fittings: Schedule 40 Type 304 stainless steel.

**Supply:** 1-1/4" NPT female top inlet.

Sign: ANSI-compliant identification sign.

**Quality Assurance:** Factory tested prior to shipment. Ships fully assembled and crated.

## **Available Options**

<b>HV</b> 240 volt heat tracing.
TL Heat trace indicator light.
SP Scald protection valve.
FP Freeze protection valve.
ALG Green area light.
<b>PS</b> Magnetically activated proximity (MAP) switch.



## **Alarm Options**

Specify desired alarm using fourth digit of model number, as follows:


- 0 No alarm.
- Single pole, double throw flow switch for remote sensing capability.
- 3 Alarm horn and remote sensing capability.
- 5 Light and remote sensing capability.
- 7 Alarm horn, light and remote sensing capability.





## $\begin{tabular}{ll} \hline \end{tabular} \begin{tabular}{ll} \textbf{GFR3500} \end{tabular} \begin{tabular}{ll} \textbf{Heated Safety Station with Eyewash, Stainless Steel Pipe/Fittings,} \\ \hline \end{tabular}$

Top Inlet, Rated for Class I, Division 2 Environment

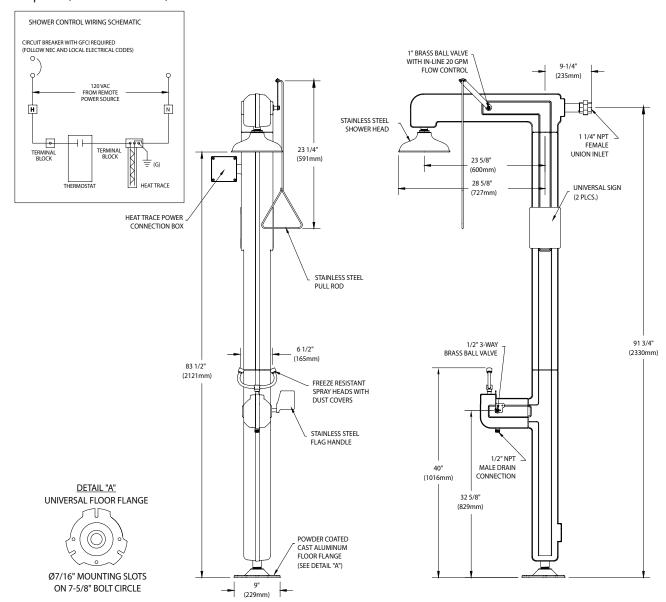

## NOTES:

- 1. FREEZE RESISTANT SPRAY HEAD ASSEMBLY WITH INTERNAL 3.2 GPM FLOW CONTROL AND FLOAT OFF DUST COVERS.
- 2. DESIGNED FOR USE IN A CLASS I, DIVISION 2, GROUPS B, C, & D ENVIRONMENT.
- 3. PEAK HEAT TRACE POWER CONSUMPTION IS 75 WATTS.
- 4. IN ORDER TO MEET CLASS I, DIVISION 2 REQUIREMENTS, APPROVED CONDUIT AND FITTINGS MUST BE USED. ALL THREADED ELECTRICAL CONNECTIONS MUST HAVE HAZARDOUS LOCATION RATED SEALANT APPLIED TO THREADS.


THIS SPACE FOR ARCHITECT/ENGINEER APPROVAL

Due to continuing product improvement, the information contained in this document is subject to change without notice. All dimensions are  $\pm$  1/4" (6mm). rev. 1116



test has Cost
and the spring factored Books

Granden





Sign Included

Chicago, IL 60642